

# SMOKE ALARM COMPLIANCE CERTIFICATE

Property Address:

**18 Bowerbird Crescent , Dakabin QLD 4503**

The below services have been completed by DC Smoke Alarms on behalf of Homey Connect and the property meets with the QLD Legislation requirements.

**Smoke Alarm Compliance Check** **COMPLIANT****All Smoke alarms are:**

- Are powered by a hardwired 240v and/or 10-year stand-alone lithium battery alarm
- Are interconnected with every other smoke alarm in the dwelling
- Are photoelectric & comply with the Australian Standard 3786:2014


**WARNING:** Failure to install compliant Smoke Alarms is an offence under the Fire and Emergency Services Act 1990.

**Inspection Date:** 29 February 2024**Compliance Technician:** Nathan McGinty**Contractor Number:** 91744**Annual Servicing Subscription Period:** N/A**Signature:** *Nathan McGinty*


## SMOKE ALARM PHOTOS

### Images from Smoke Alarm Compliance Check



	Smoke Alarms	Location	Brand	Expiry	Alarm	Inter/C	Reason
✓	Yes	Hall o/s Bedrooms	Emerald Planet	01-04-2033	HW 240V	RF	Replaced expired alarms onsite

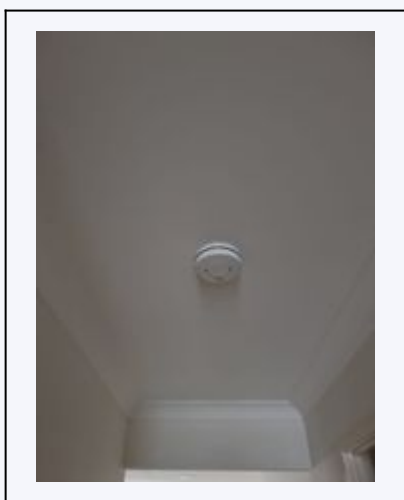


	Smoke Alarms	Location	Brand	Expiry	Alarm	Inter/C	Reason
✓	Yes	Bedroom 1	Emerald Planet	01-05-2033	10 YR LT	RF	Additional alarm installed for compliance

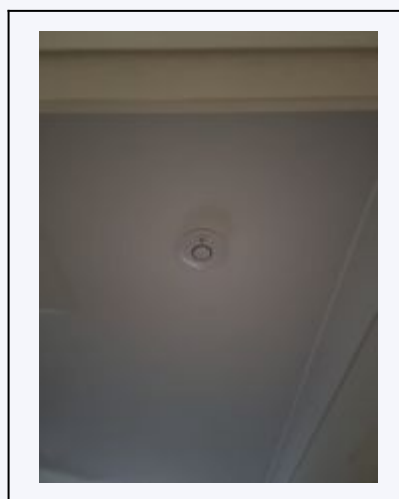

	Smoke Alarms	Location	Brand	Expiry	Alarm	Inter/C	Reason
✓	Yes	Entry	Emerald Planet	01-04-2033	HW 240V	Wire	Replaced expired alarms onsite

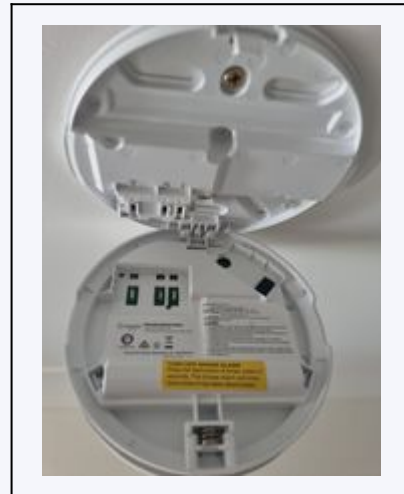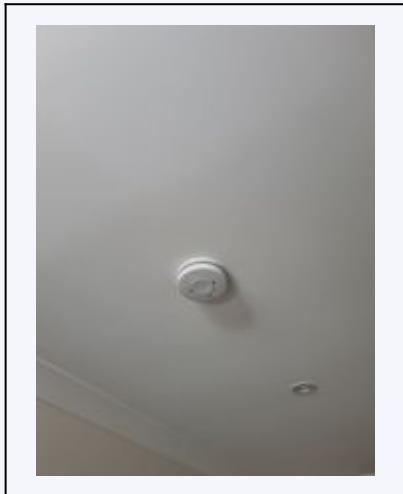

	Smoke Alarms	Location	Brand	Expiry	Alarm	Inter/C	Reason
✓	Yes	Bedroom 2	Emerald Planet	01-05-2033	10 YR LT	RF	Additional alarm installed for compliance

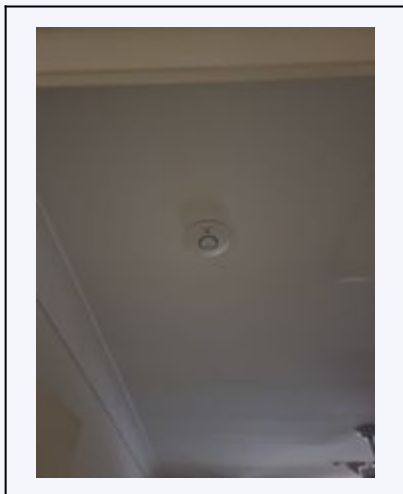

	Smoke Alarms	Location	Brand	Expiry	Alarm	Inter/C	Reason
✓	Yes	Bedroom 3	Emerald Planet	01-05-2033	10 YR LT	RF	Standard Service

